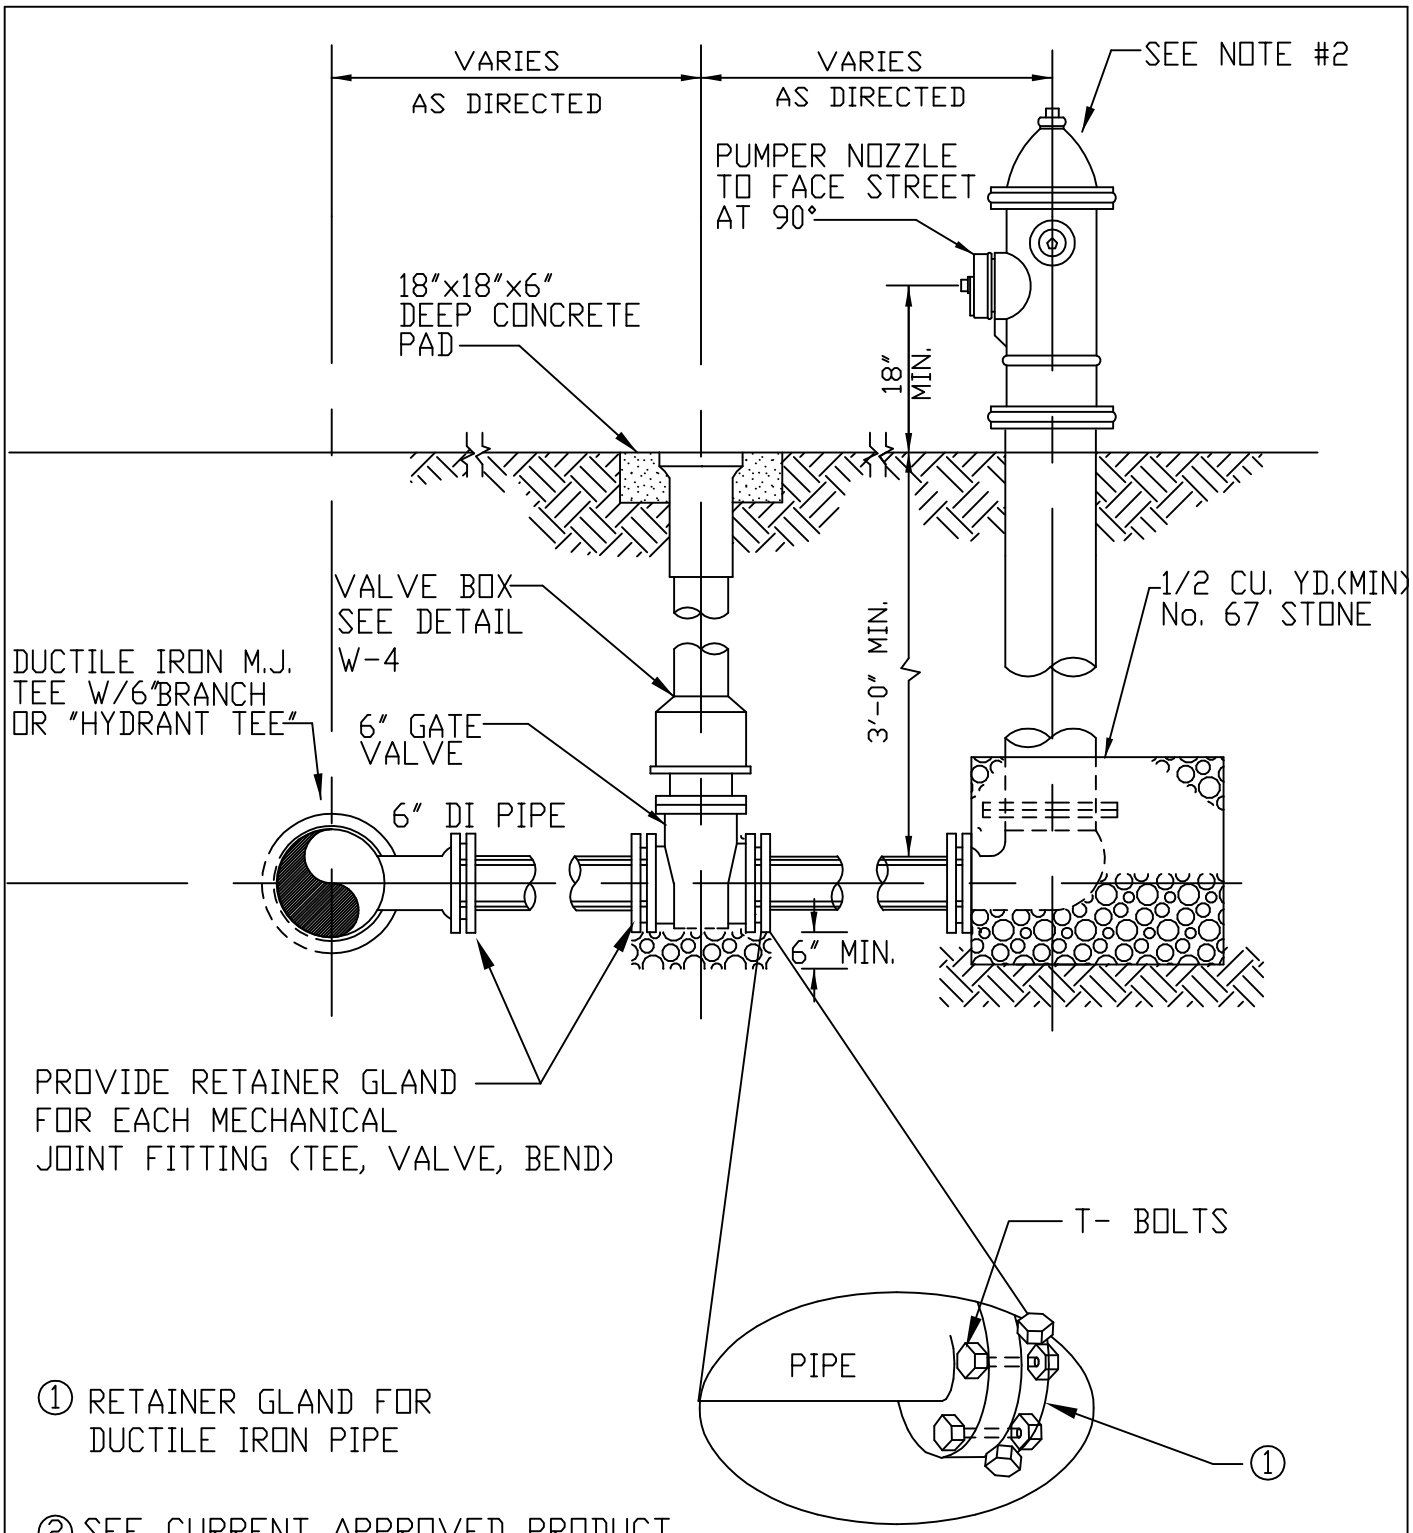

① RETAINER GLAND FOR DUCTILE IRON PIPE

② SEE CURRENT APPROVED PRODUCT MANUFACTURERS SHEET FOR APPROVED TYPES (APPENDIX "A")

CITY OF SALISBURY, N.C. STANDARD DETAIL	DATE: OCTOBER 17, 2006
WATER SYSTEMS FIRE HYDRANT	NOT TO SCALE
	STANDARD W-3